BigBattery

Own Your Power

48V HUSKY 2 PWR USER MANUAL

(High Power Version)



APPLIES TO:

48V HUSKY 2

(SKU: FHSKY-48051-G2-PWR)

Version 1.7

© 2025 BIGBATTERY, LLC. ALL RIGHTS RESERVED
VERSION 1.7 | INFORMATION SUBJECT TO CHANGE WITHOUT NOTICE
MODEL SKU: FHSKY-48051-G2-PWR

SCAN THE QR CODE FOR THE LATEST VERSION

VERSION HISTORY

Edition	Date	Chapters	Reason for Change
1.1	12/26/2023	All	Manual development
1.2	02/29/2023	5.2	Specs
1.3	09/04/2024	All	Formatting Updates
1.4	07/01/2025	All	Document Revision
1.5	07/24/2025	7	Module ID Explanation
1.6	10/07/2025	All	New On/Off Button
1.7	03/26/2026	5.2	Spec Sheet Modified

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.

Table of Contents

1. Definition of Terms.....3
2. Safety Instructions.....4
3. Introduction.....6
    3.1. Product Description.....6
    3.2. Features & Applications.....7
4. Packed Components.....7
    4.1. 48V HUSKY 2.....7
5. Product Specifications.....8
    5.1. Battery Overview.....8
    5.2. Battery Specifications.....9
    5.3. Battery Diagram.....10
    5.4. Battery Communication Ports.....11
    5.5. Battery LED Indicators.....11
6. Installation.....12
    6.1. Installation Safety Guidelines.....12
    6.2. Battery Installation.....12
7. Battery Commissioning.....16
    7.1. Battery Configuration.....16
8. Battery Operation Guide.....18
    8.1. Charging.....18
    8.2 Discharging.....19
    8.3 State of Charge.....19
    8.3 Storage.....19
    8.4 Extend the life of your Battery.....20
9. Service.....21
    9.1 Troubleshooting.....21
    9.2 Maintenance.....22
10. Recycling.....23
11. Warranty & Returns.....23

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.

1. Definition of Terms

- AWG – American Wire Gauge
- A — Amp(s)
- Ah — Amp hour(s)
- AC — Alternating Current
- Battery Module — Single battery
- Battery System — Two or more battery modules connected to a controller box
- BMS — Battery Management System
- Capacity — Measure of stored energy, typically in Ah or mAh
- Controller Box — Master BMS Unit
- Cell Balancing — Process of ensuring uniform charge among cells in a battery
- Cycle Life — Total charge-discharge cycles before capacity decline
- C-rating — Charging/discharging rate relative to battery capacity
- DC — Direct Current
- DOD – Depth of Discharge
- ESS – Energy Storage System
- kW — Kilowatt
- kWh — Kilowatt-hour
- LFP — Lithium Iron Phosphate or LiFePO4
- mm — Millimeter(s)
- mV — Millivolt(s)
- Overcharge — Charging beyond recommended voltage limits
- PPE — Personal Protective Equipment
- PV — Photovoltaic
- Self-Discharge — Natural battery discharge over time
- State of Charge (SOC) — Battery's remaining charge as a percentage
- State of Health (SOH) — Overall battery condition and performance
- Thermal Runaway — Dangerous overheating with potential battery damage
- V — Volt(s)

2. Safety Instructions

Before you start working, make sure to read and follow all safety instructions for handling the battery. When installing it, be sure to meet all the rules and regulations in your area. Ask your local authority for the right permits and approvals before you install it.

Lithium Iron Phosphate (LiFePO4) batteries are an inherently safe chemistry. However, safety measures should always be taken as consideration before, during, and after installation and during ongoing use and maintenance. The following safety notices are crucial for both the installer and end users when operating this product normally.

Improper installation could result in harm to the installer, the operator, or others, as well as damage to the battery or connected equipment.

WARNING:

- Do not make any connections or disconnections to the system when the batteries are in operation. Working with active batteries can lead to system component damage or pose a risk of electrical shock.
- Do not charge with a charge voltage above the specified on section 5.2.
- Do not charge nor discharge battery when ambient temperature is above **55** °C (**131** °F).
- Do not install battery where it may contact conductive materials, water, seawater, strong oxidizers, nor strong acids.
- Do not install battery in a location exposed to direct sun, hot surfaces, nor hot locations. Do not install batteries in a tight clearance compartment, overheating may result.
- Keep any flammable/combustible material (e.g. paper, cloth, plastic, etc.) that may be ignited by heat, sparks, flames, or any other heat source at a minimum distance of two feet away from the batteries.
- Disconnect batteries immediately if, during operation or charging, they emit an unusual smell, develop heat, or behave abnormally.
- Have a Class ABC or Class BC fire extinguisher on the premises.
- Never short-circuit DC inputs: may result in a risk of electric shock or fire.
- Do not disassemble the battery: Contact BigBattery for proper handling instructions. Incorrect servicing or re-assembly may result in a risk of electric shock or fire and voiding the warranty

PRECAUTION:

- Qualified personnel must handle all product work to reduce the risk of electric shock.
- Follow local and national electrical standards for installation and confirm utility provider and local authorities requirements before grid connection.
- Maintain visibility of warning labels and nameplates.
- Choose battery placement with future user safety in mind.
- Keep children away from the battery and systems.
- Use team lift technique due to battery weight.
- Use batteries as directed; do not open or modify.
- Avoid inserting foreign objects into battery terminals.
- Handle batteries and/or battery-powered devices cautiously when using metal tools or when around the system. Risk of electrical arcs or short-circuits can cause serious harm, death, and equipment damage.
- Do not charge or discharge the battery if ambient temperature is below **-20** °C (**-4** °F).
- Beware of the battery current: Please ensure that the battery is “off” before installing or working on the battery. Use a voltmeter to confirm there is no voltage present.
- Always wear protective gear when handling batteries (PPE).
- Handle batteries carefully to prevent damage; avoid pulling, dragging, or mishandling.
- Inspect batteries before use; don't use damaged or swollen ones; contact BigBattery immediately.
- Don't paint any part of the batteries, inside or out.
- Make sure all cable connections are properly tightened and secured, and to prevent any accident caused by improper installation.
- Install and remove batteries using the handles provided.
- Do not place any objects on top of batteries.
- Before storing battery for more than 6 months, fully charge the battery and disconnect batteries from your system.

Disclaimer:

BigBattery, LLC has the authority to modify the content here without prior notice. To access the latest manual version, please visit our website at www.bigbattery.com.

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.

3. Introduction

Introducing BigBattery's 48V HUSKY 2 HighPower Version! These revolutionary lithium battery systems designed to push the boundaries of efficiency, flexibility, and reliability in energy management are the BEST Batteries Money can Buy. The 48V HUSKY 2 represents a leap forward in energy storage technology, offering a compact and scalable solution for seamlessly integrating renewable energy sources into your home, business, or mobile applications. With its cutting-edge features and intelligent design, this advanced lithium battery system promises to empower individuals and organizations to take control of their energy usage like never before. Equipped with one of our HUSKY 2 battery systems from BigBattery, you'll stay powered & prepared!

This User Manual is designed to provide you with an understanding of the specs, features, capabilities, and installation of these batteries. Read and take note of all safety information prior to installing or operating your battery. This document applies to the 48V (FHSKY-48051-G2-PWR) HUSKY battery systems.

3.1. Product Description

The 48V 5kWh HUSKY 2 (High Power Version) battery system is ideal for low-voltage applications and for your golf carts, boats, ATVs and more. Each single battery module is 5.12kWh and it can be expanded up to 80 kWh when connecting in parallel. These batteries utilize lithium iron phosphate (LiFePO4 or LFP) cells, renowned for their top-notch safety.

They are water resistant and equipped with an intelligent Battery Management System (BMS) that continuously monitors and records cell voltage, along with real-time data on current, voltage, and temperature for the module. The BMS features a passive balance function and an advanced battery control method, which collectively enhance battery pack performance. Furthermore, the battery includes built-in fire-extinguishing modules for added safety. It has built-in heating elements so the battery can be charged in freezing environments temperatures.The battery utilizes a standard M8 bolt connection, which easily and safely secures power to your battery unit. Designed to endure, the HUSKY 2 has a lifespan of over 10 years and is engineered to withstand more than 4000 - 6000 cycles at 80% Depth of Discharge (DOD) at a rate of 0.5C°.

You can always monitor the batteries' capacity with the State of Charge meter or check the battery's health and performance from your phone with the bluetooth BIgBatteryApp, which will display information of the condition of your battery. If needed you can connect the HUSKY 2 State of Charge Meter so you can monitor your battery from the dashboard.

3.2. Features & Applications

Applications:

- **Golf carts**
- **ATVs**
- **RVs**
- **Boats, etc**

Features:

- Advanced BMS (Battery Management System)
- Lithium-Ion LiFePO4/LFP Chemistry
- Easy connection to a larger power system
- Expandable system with easy parallel connections
- Multiple layers of safety and battery protection
- Built-in heating system
- Built-in fire suppression system
- Impact Resistant
- Water resistant
- Good insulation performance
- High quality & durable ABS construction
- Utilizes standardized M8-bolt connector for battery power source.
- Parallel Communication
- CAN bus and RS-485 communication for parallel communication
- RJ-45 ports
- LED SOC Meter
- Mobile Monitor Application
- External SOC Meter

4. Packed Components

4.1. 48V HUSKY 2



(X1) 48V 5.2 kWh HUSKY2
(FHSKY-48051-G2-PWR)



(x2) Battery Handles



(x1) Ring Terminal Rubber Covers



(x1) 2awg Ring Terminal Cable Pair (3ft)

ADD ONS




SOC Battery Meter
(MTR108)

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.

5. Product Specifications

5.1. Battery Overview

Figure 1: **HUSKY 2 Battery Overview**

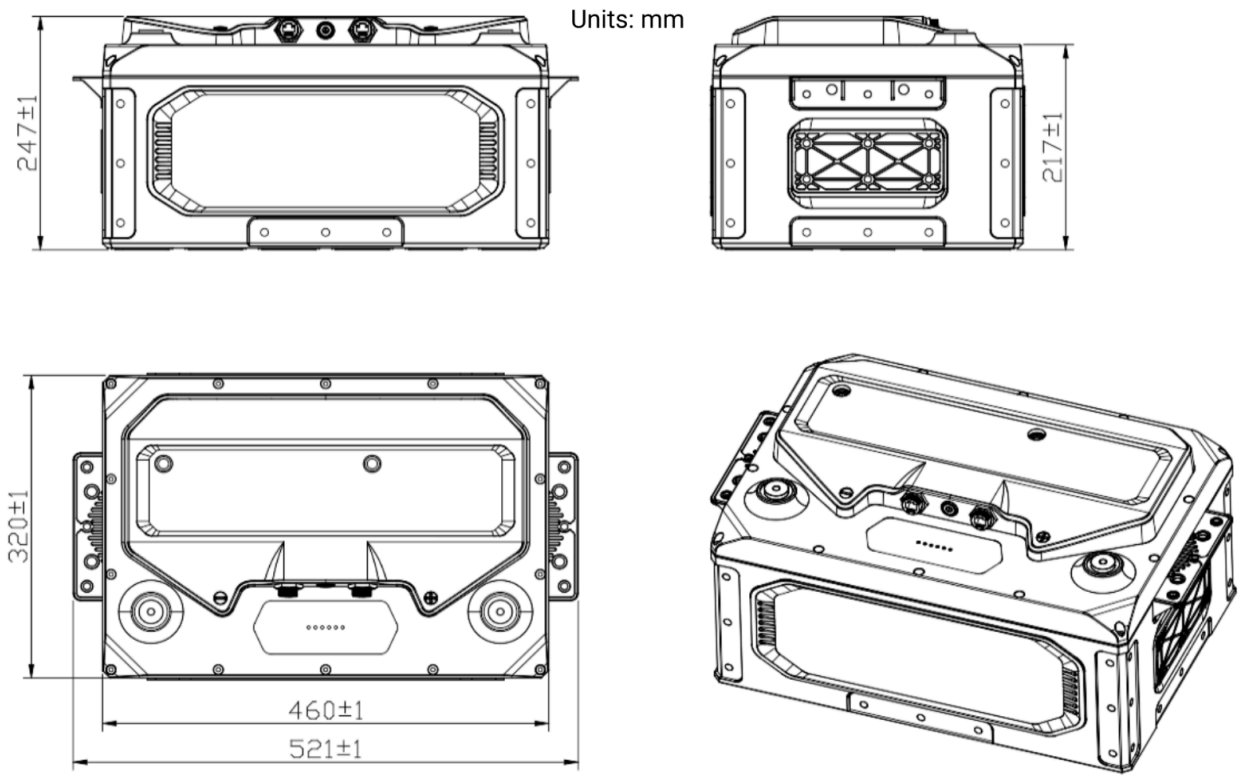

Before handling the battery, always switch it off and verify there is no voltage with a voltmeter to prevent accidental contact with live terminals. Failure to do so could lead to severe injury or fatality.

5.2. Battery Specifications

BATTERY SPECIFICATIONS



48V


SKU	FHSKY-48051-G2-PWR
System Voltage	48V
Nominal Voltage	51.2V
Chemistry	LiFePO4
kWh Capacity	5.12 kWh
Ah Capacity	100 Ah
Charging Voltage Range	55.6V - 57V
Max Charge Voltage	57.6V
Operating Voltage Range	48V - 57V
Suggested Low Voltage Cutoff	48V - 50.8V
BMS Cutoff Range	42V - 47V
Cell Configuration	16S
Max Cont. Discharge Current	160A
Peak Discharge Current	350A (Max 10 seconds)
Instantaneous Current	800A (Max 0.1 ms)
Max Charge Current	100A
Charge Temperature Range	-4°F - 160°F
Discharge Temperature Range	-4°F - 160°F
Optimal Discharge Temp. Range	59°F - 95°F
Storage Temp. Range (SoC >50%)	-4°F - 122°F (Max 6 months)
Dimensions (DxWxH)	12.6 x 18.1 x 9.8 in (320 x 460 x 249 mm)
Weight	100 lbs (45.4 kg)
Max Connections	Up to (16) Parallel
Protection Rating	IP65 / NEMA 4X
Communications	CANBus / RS485
Heating Function	Yes

Last Revision Date: 03/26/2026

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.

5.3. Battery Diagram


Figure 2: **HUSKY 2 Battery Diagram**

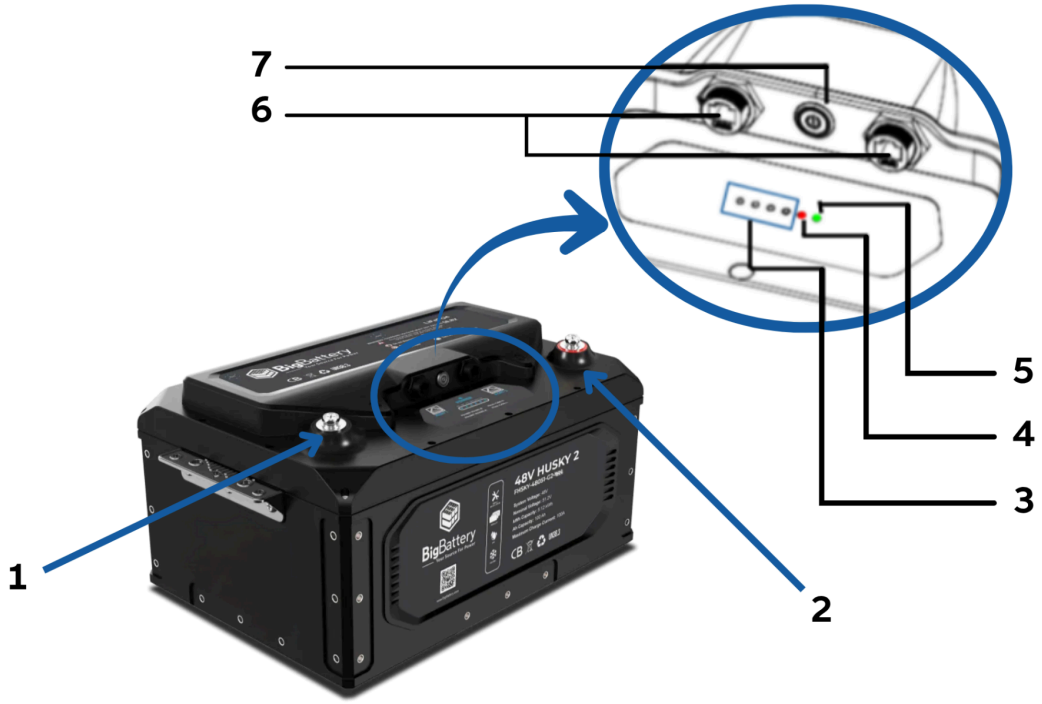

Item	Name	Description	Details
1	BAT-	Negative Battery Terminal	M8 Screw
2	BAT+	Positive Battery Terminal	M8 Screw
3	SOC	Battery State of Charge LEDS Indicators	4 LEDS On = 100% 3 LEDS On = 75% 2 LEDS On = 50% 1 LED On = 25%
4	Alarm	Alarm LED Indicator	
5	On LED	ON/Operating LED Indicator	
6	RS485/CAN	RJ45 Communication Port	RS485/CAN
7	On/Off Button*	Press-and-hold On/Off Button **	

* Starting **September 2025**, the On/Off switch was replaced with a hold-button version.
****Turning On:** Press and hold the On/Off button for 2–4 seconds, then release.
****Turning Off:** Press and hold the On/Off button for 2–4 seconds, then release.
Note: Holding the button longer may prevent the battery from turning off.

5.4. Battery Communication Ports



Pin	Details
1	CAN-H
2	CAN-L
3	GND
4	LIN
5	WARK
6	12V
7	RS485 A+（T/R+）
8	RS485 B-（T/R-）

Note: Both RJ45 Communication Port can be used for RS485 or CAN protocols for parallel communication (not inverter compatible).

5.5. Battery LED Indicators

Status	Operation	RUN *	Alarm *	SOC ****	Notes
Shutdown / Sleep		OFF	OFF	OFF	
Stand by	Normal	ON	OFF	4 LEDS On = 100% 3 LEDS On = 75% 2 LEDS On = 50% 1 LED On = 25%	-
Charge	Normal	Flash 1	OFF		Flash 1 OFF：1.0S ON：1.0S
	Alarm	Flash 1	OFF		
	End-Off Voltage	ON	OFF		
	Over-Temp / Over-Current Protection	OFF	ON		
Discharge	Normal	Flash 2	OFF		Flash 2 OFF：0.5 S ON：0.5 S
	Alarm	Flash 2	OFF		
	End-Off Voltage	OFF	ON		
	Over-Temp / Over-Current Protection	OFF	ON		

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.

6. Installation

WARNING: Before installing, make sure to review all warnings and precautions in Section 2, as well as the installation safety guidelines in Section 6.1 below.

6.1. Installation Safety Guidelines

- Inspect batteries upon receipt for any signs of damage before use. In case of battery damage, reach out to BigBattery for repair or replacement. Avoid using a defective battery as it may result in incorrect battery voltage that could potentially ruin your appliances. Damaged batteries have the potential to cause fire hazards.
- Check to ensure that all cables are in good condition.
- Be sure your battery packs are powered "**OFF**" before making/removing any connections.
- It is crucial to never create a short circuit on the external battery terminals. When attaching the battery, ensure that each cable is properly connected to the correct terminal. There should be no conductive material between the terminals that could cause a short circuit.
- Use a screwdriver with a rubber coated handle.
- **Do not put the HUSKY 2 batteries in series.** The BMS and internal components are not designed to handle this setup, which could cause the modules to fail.
- Always mount the battery in an upright position.

6.2. Battery Installation


①

Place the battery on a flat floor or shelf.

②


Take off the "handle" from the case, and the metal piece can become a "ground mounting bracket" for securing the battery to the floor with an electric drill. If placed on the battery's side, it can be a "back mounting bracket" to attach the battery to the wall using an electric drill, as shown in figure 3;

***Figure 3: Single* HUSKY 2 Mounting Installation**

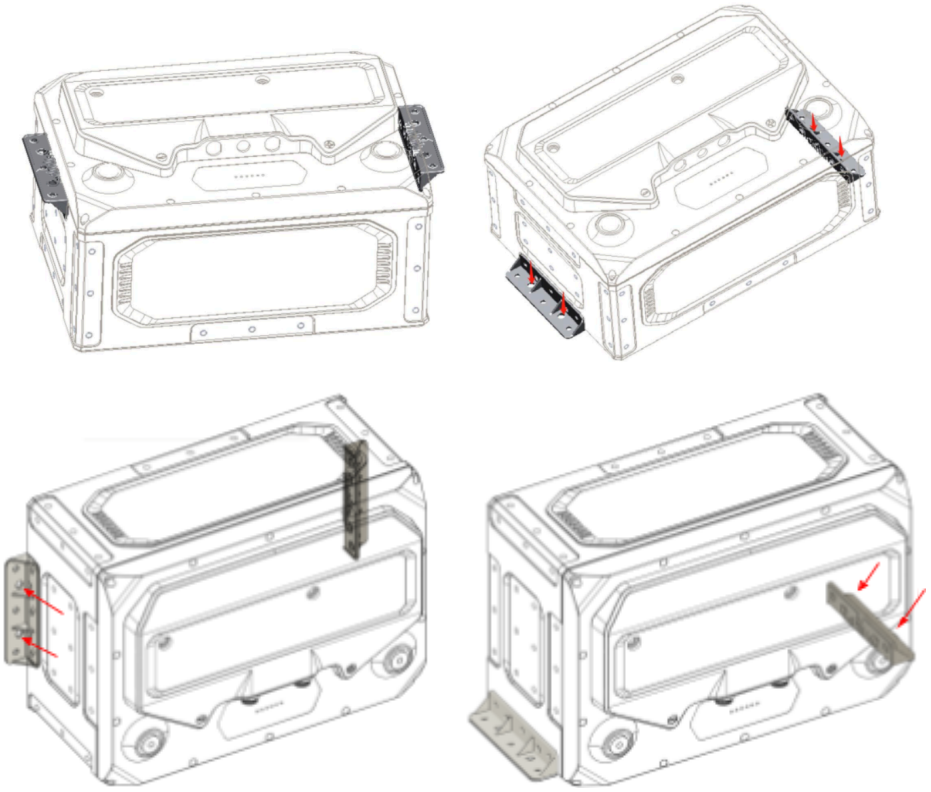


③ When connecting several batteries in parallel, you can utilize the rectangular metal strip as a linking plate, and secure the batteries together using an electric wrench, as shown in figure 4.

***Figure 4:* HUSKY 2 Mounting Batteries in Parallel**

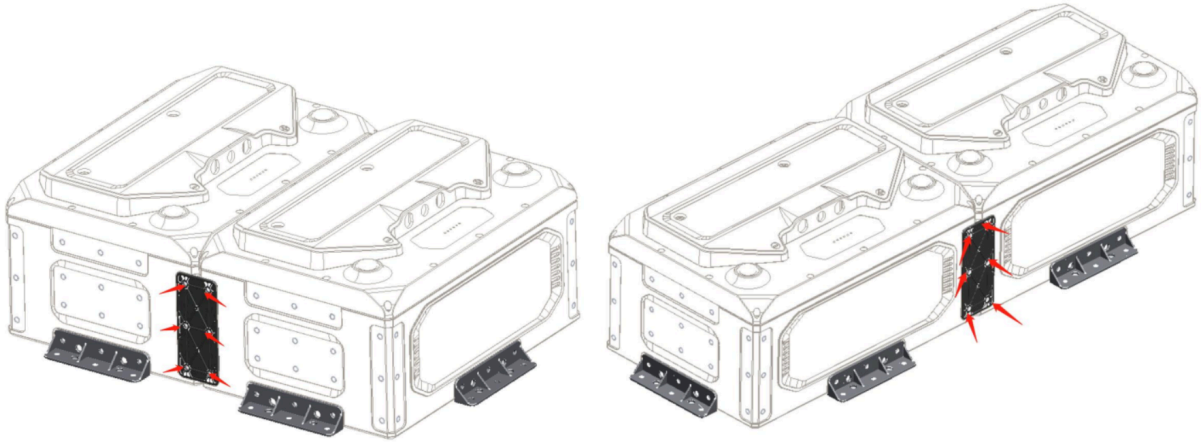


\

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.

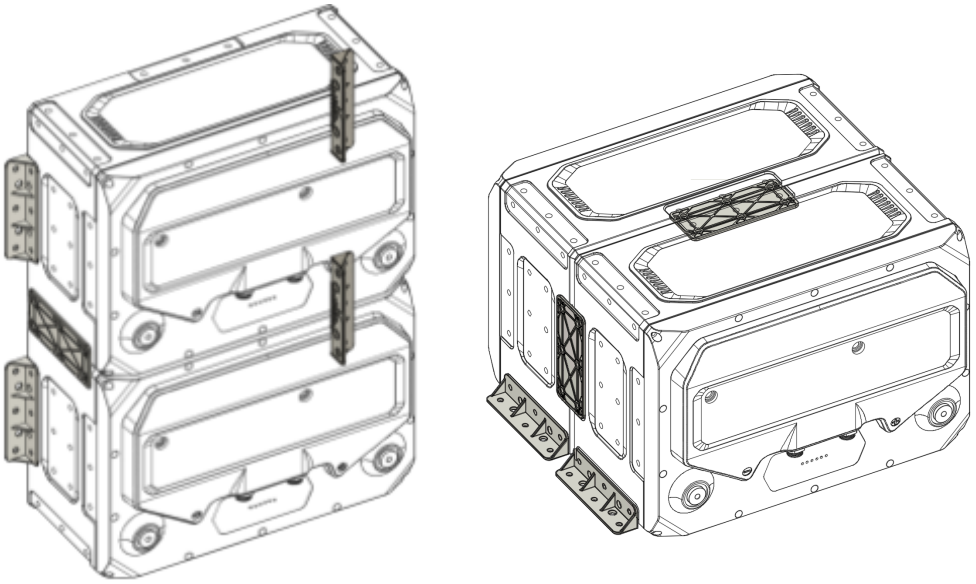

④ When using a single battery, connect it directly to the system using the power cables and set its ID to 1. For systems with multiple batteries in parallel, designate one battery as the master (ID 1) and connect it to the system. The remaining batteries act as slaves and should be connected in a daisy-chain using UTP communication cables, linking their communication ports in sequence as shown in Figure 5. Assign each slave battery a unique ID in ascending order (e.g., ID 2, ID 3, etc.) to ensure proper communication between all batteries and the meter. Go to section 7.1 to learn how to change the ID. If using the SOC Meter, connect it to Battery with ID 1.


Figure 5: **HUSKY 2 Comm Cable Connection Diagram**

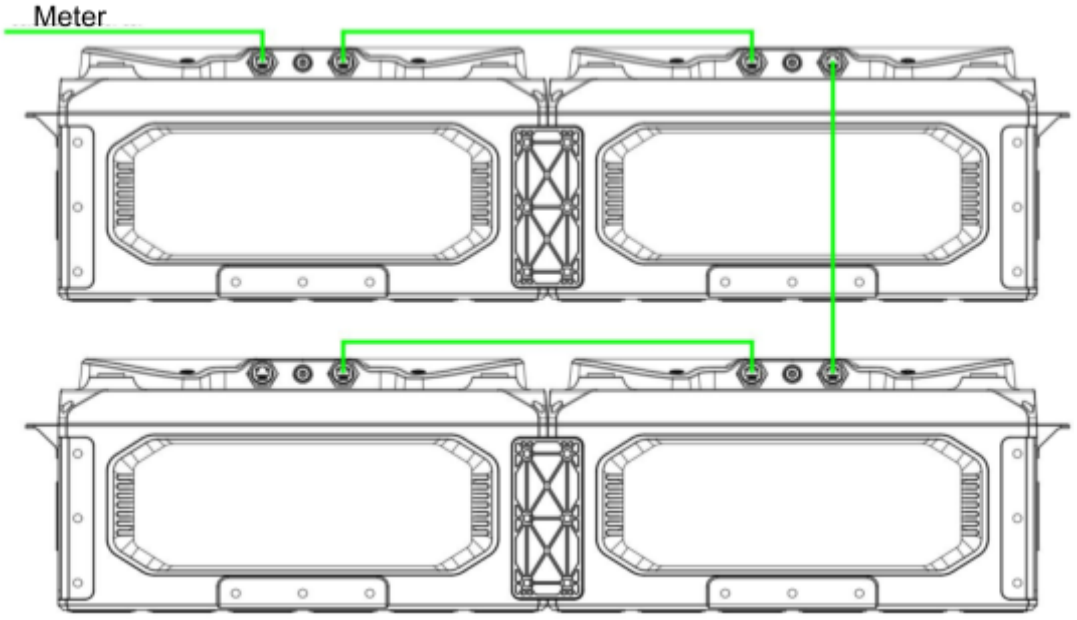


⑤

Connect the power cables in parallel. In other words, using the battery power ring terminal cables connect all the positives to each other, and the negatives to each negative connector, as shown in figure 6;

Figure 6: **HUSKY 2 Power Cable Connection Diagram**

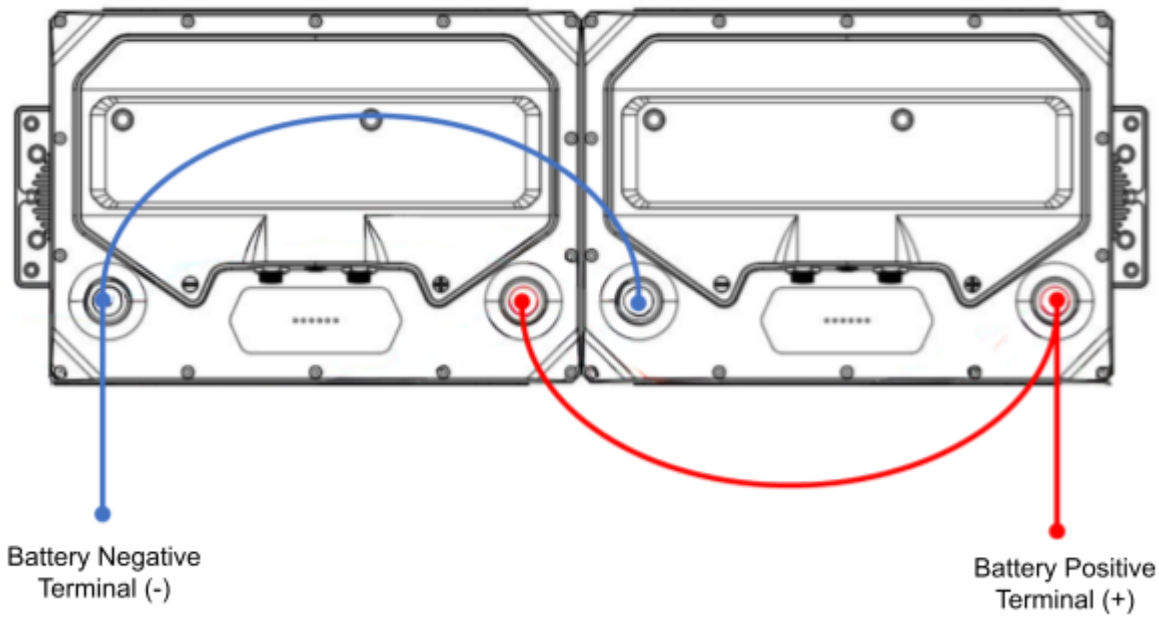

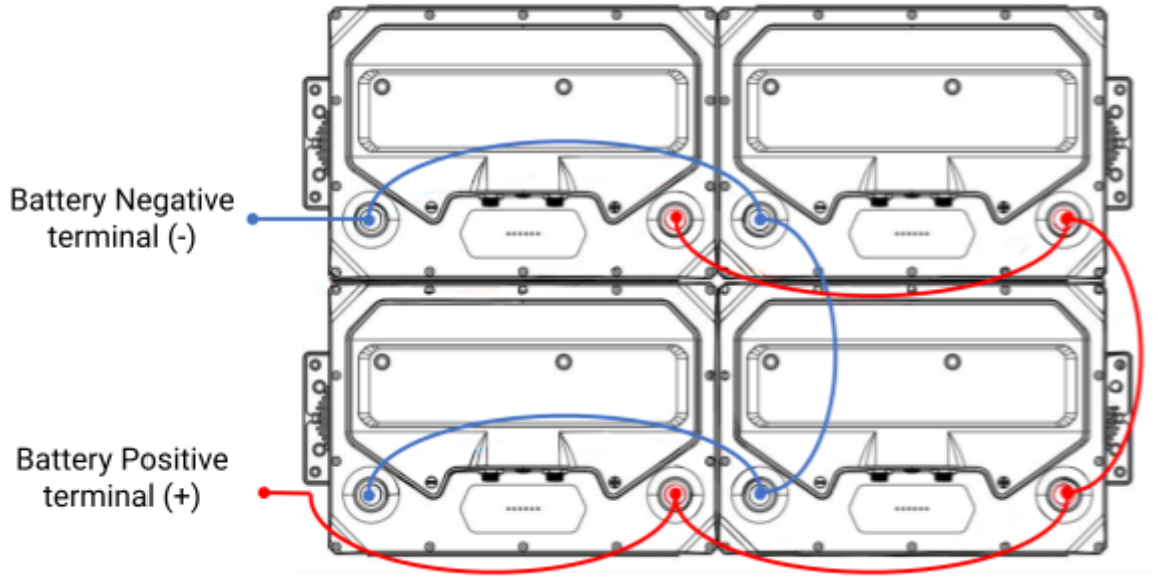

⑥

Connect the Battery Positive and Negative Terminal to your golf cart's motor controller.


7. Battery Commissioning

In order for the batteries to communicate with each other, they need to have their ID changed accordingly through the mobile app.

7.1. Battery Configuration

① Search for “BigBattery Husky 2” APP on the Apple Store or “Battery Monitor BL” in the Play Store and download it, as shown in figure 7.

Figure 7: **App Store Download**

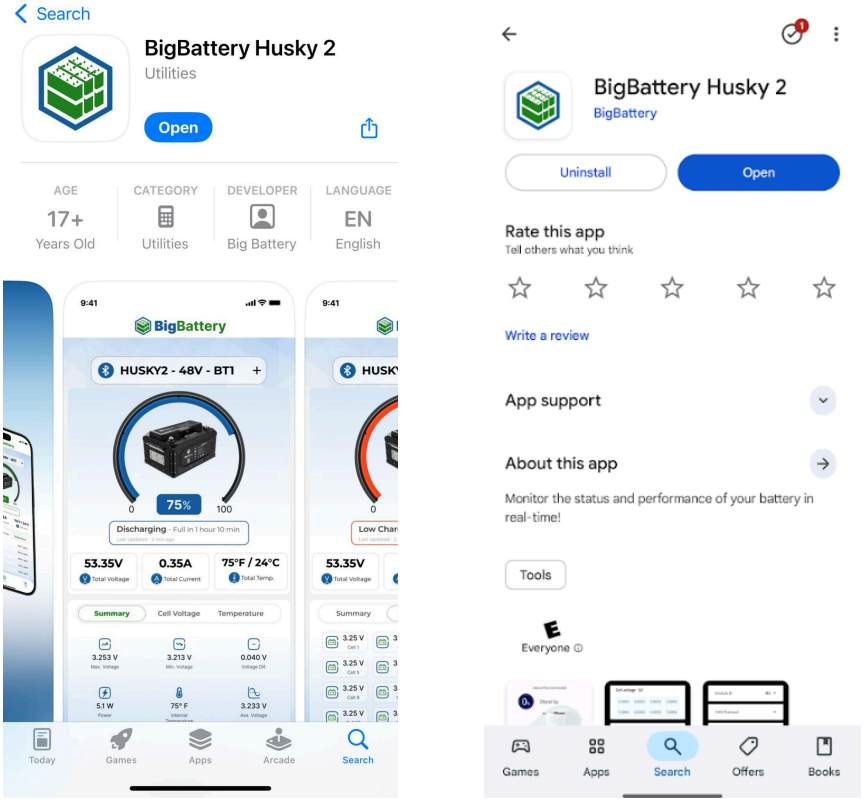


APP STORE PLAY STORE

② Open the App and turn the HUSKY 2 battery ON. For batteries with the hold-button version, press and hold the On/Off button for 2–4 seconds, then release.

③ Connect the HUSKY 2 battery and the APP by Bluetooth. Search for batteries and connect it according to the battery’s Bluetooth label (located at the left side of the battery); then click “Connect”. It will display the battery information, as shown in Fig. 8.

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.


Figure 8: **App and HUSKY 2 Battery Connection**

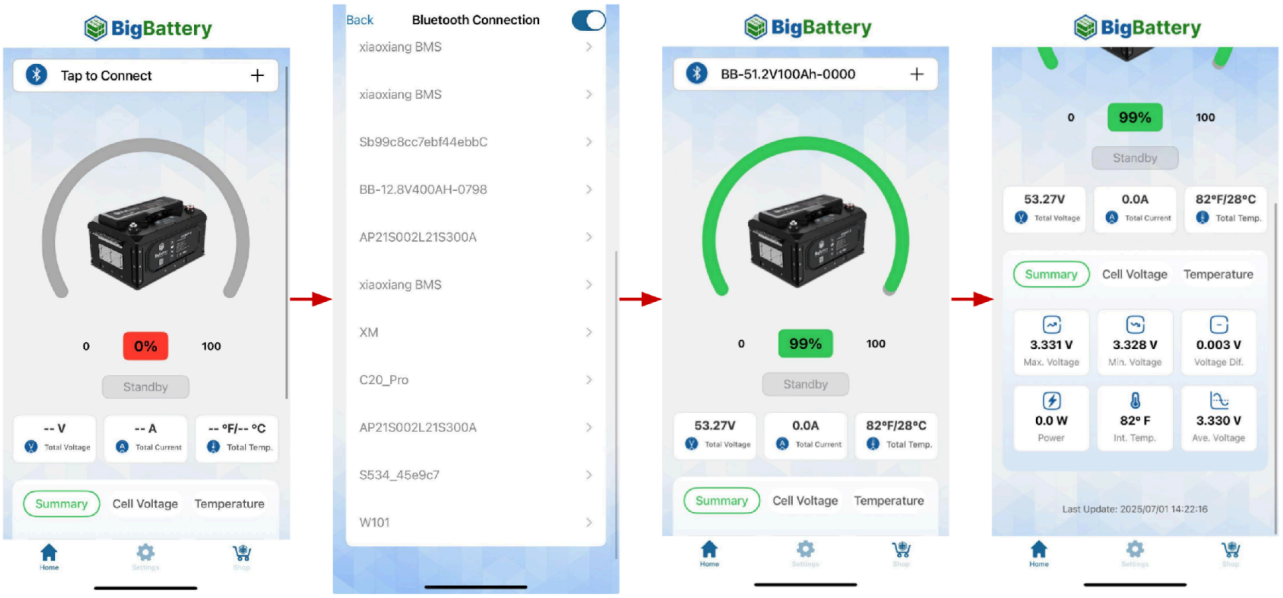

APP STORE & PLAY STORE

④ Select the ID address. Enter the settings interface. Click on "Module ID", select the appropriate ID (defaults=1). Make sure the battery connected to the meter has Module ID ”1”. For systems with multiple batteries in parallel, designate one battery as the master (Module ID “1”) and connect it to the meter. The remaining batteries act as slaves. Assign each slave battery a unique ID in ascending order (e.g., ID 2, ID 3, etc.) to ensure proper communication between all batteries and the meter.

Figure 9: **Module ID Configuration**

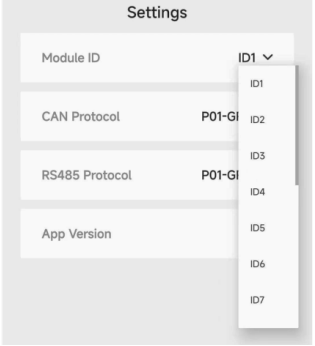

8. Battery Operation Guide

⚠ **WARNING**: Before installing, make sure to review all the parameters listed on chapter 5.2.

8.1. Charging

- During the initial charging, monitor the battery's charge voltage to ensure it is within appropriate voltage limits.
- Only use the battery charger provided by BigBattery, or the inverter charging settings listed on section 5.2. Using non-recommended chargers may cause improper charging and damage the battery's capacity.
- The battery can be charged in freezing temperatures (-20 °C / -4 °F) thanks to a heating element. When charging is detected, the heating will start until the battery temperature is above 0°C / 32°F and then the charging will start.
- Use LiFePO4 batteries for "opportunity charging." Charge them whenever you can but do it with small amounts of energy. It's better to do this than using fast chargers. Fast charging can make the battery's life shorter.
- It is suggested to charge the battery when it has a minimum of 10-20% SOC. Deep discharge won't harm the battery's health, but the BMS requires some voltage to function properly.
- The Bulk/Absorb Voltage of an LFP battery is the same as the charging voltage. BigBattery products do not need Float Voltage, Equalize voltage or absorption time.


8.2 Discharging

- The battery can be fully discharged. Unlike lead-acid batteries, the Voltage of a lithium battery stays very constant during discharge, delivering the same amount of power and energy from 100% to 0% SOC.
- LFP batteries handle discharging to 0% safely, but shallower cycles offer benefits. Opting for 20% SOC, instead of 0%, extends the battery's lifespan to more than 6000 cycles.
- Do not discharge if the temperature is above 55 °C / 131 °F.
- You will see an apparent loss of capacity when discharging at below-freezing temperatures that reverses when the battery gets above freezing.

- The BMS will automatically shut down when the battery reaches a low voltage, so there's no need for manual intervention. Avoid over discharging by removing the load when the battery's discharge is done.

8.3 State of Charge

This is the Depth of Discharge of the HUSKY 2 family batteries:

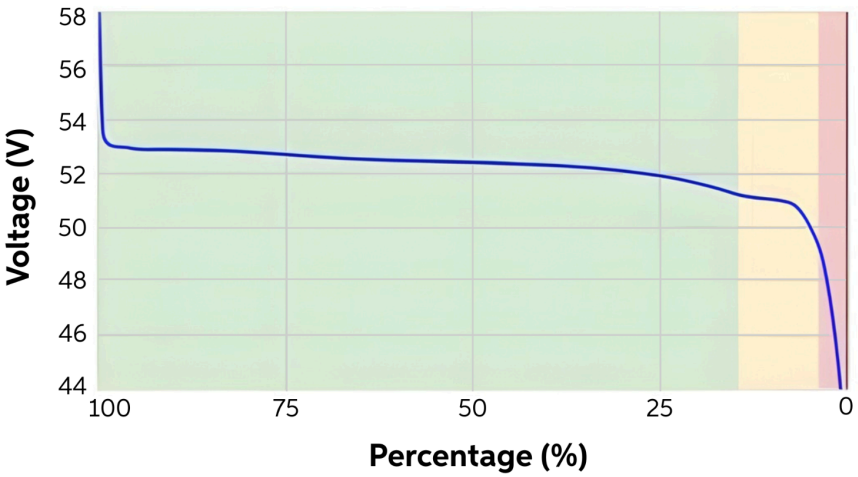

	Cycling in this zone will ensure a reasonable life expentancy
	Ocassionally this zone is OK
	Dropping into this zone can lock the battery. Could reduce lifespan.

8.3 Storage

- LFP batteries have an extremely low self-discharge rate, which makes long-term storage convenient. Storing a lithium battery for up to a year is not an issue, as long as it has some charge remaining before being placed in storage.
- Before storing lithium batteries, charge them to at least 50% capacity. Do not store batteries that are fully discharged. In the case of a fully charged battery, it should be discharged to 80% before it is stored.
- If you need to store batteries for longer periods, be sure to simply disconnect all wires from them. That way there can not be any stray loads that slowly discharge the batteries.
- Make sure that you store the battery within the temperatures listed on section 5.2. Storing them at low temperatures is certainly much better than storage at high temperatures. The electrolyte in LiFePO4 cells does

not contain any water, so even when it freezes it does not expand, and does not damage the cells. Just let the battery warm up a bit before you start discharging it again, which is OK at -4 °F (-20 °C).

This is the storage temperature that the batteries should be stored, and the charging intervals and methods to do so.

Storage Temperature	Charging Interval	Charging Method	Model
≤20℃	Once / 9M	56V 30A CC/CV Charging to 56V, cut-off current：5A	48V HUSKY 2
20℃～30℃	Once / 6M		
30℃～40℃	Once / 3M		

8.4 Extend the life of your Battery

THe HUSKY 2 Battery is designed 10 years or more when used correctly. To ensure a proper battery operation, you must follow the previous listed instructions and battery parameters. In order to extend the lifespan of your battery, follow these recommendations.

- Avoid discharging the battery more than 80% Depth of Discharge (DOD) unless it is truly necessary.
- Keep the battery temperature under 95 °F (35°C) and above 59°F (15 °C)
- Keep battery charge and discharge current under 0.5 of the Capacity
- Never disassemble the battery, unless our tech support guides you. If the battery has any problems, contact us for assistance.
- Keep the battery away from excessive physical shocks or vibration.
- Dirty battery terminals can lead to improper flow of current during operation. Therefore, it is recommended that you clean the terminals while installing the battery pack.

9. Service

9.1 Troubleshooting

No.	Error	Description	Solution
1	No DC output	Battery is off or low voltage	Turn on* or charge the battery
2	Power supply time is too short	Battery capacity lack or not fully charged	Fully Charge the battery. Maintenance or replacement

3	Battery can't be charged fully	Power system DC output voltage falls below the minimum charge voltage	Regulating DC output voltage of power supply to battery suitable charging voltage
4	ALM LED always lights	Power line connection short circuit	Disconnect the power cable and check all cables
5	The battery output voltage is unstable	Battery management system do not operate normally	Press the switch to restart the battery
6	The charge and discharge capacity is insufficient	Unbalance voltage with cell	Examine/balance the cell
7	Unable to charge and discharge	BMS or cell/temperature sensor damaged	Maintenance or replacement
8	Different SOC value of batteries in parallel	Normal phenomenon	No operation
9	Alarm is ON	Current Protection	Charging or Discharging Current is too high and needs to be reduced.
10	Alarm is ON	Over Temperature	Turn off** the battery and cool down the location however possible.
11	Alarm is ON	End-Off Voltage	Charge the battery

* **Turning On:** Press and hold the On/Off button for 2–4 seconds, then release.
** **Turning Off:** Press and hold the On/Off button for 2–4 seconds, then release.
Note: Holding the button longer may prevent the battery from turning off.

9.2 Maintenance

Item	Maintenance	Maintenance Intervals
Power Cables	Check whether there is mechanical damage to the power cable and whether the terminal insulation sleeve has fallen off; if there is such a phenomenon, please turn off the machine and carry out maintenance or replacement	Once every 6 months
	Check if the power cable is loose; if there is any sign of looseness, use a standard torque wrench to tighten	
	Check the system for loose screws or discoloration of the copper bus bar; if the screws are loose, please tighten them with a standard torque wrench; if the copper	

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.

	bus bar is discolored, please contact the manufacturer for after-sales replacement	
Comm Cables	Check whether the parallel communication cable terminal is loose, if it is loose, re-tighten it	Once a year
	Check whether the color of the communication cable has obvious discoloration, if discoloration, please shut down the machine to replace the communication cable	
Cabinet	Check the cleanliness of the front door, back door and battery module inside the cabinet, if there is obvious dusty, please clean up in time.	Once 6-12 months
System Running Status	Check if all parameters are normal when the system is running (voltage, current, temperature, etc.)	Once every 6 months
	Check whether the main core components of the system are normal, including system switches, contactors, etc.	
	Check whether the system air inlet and outlet, air ducts are normal, if there is blockage and congestion, need to clean up in time	
Charge and Discharge Maintenance	Use light load and shallow charge/discharge to check whether the SOC, SOH status of the battery is normal (using the upper computer software to read); it is recommended that the depth of discharge and charge/discharge power should not exceed 20% of the rated value	Once every 6 months

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.

10. Recycling

Lithium iron phosphate batteries are potentially dangerous and shouldn't be tossed in the trash. Many websites and organizations can recycle them for free. If you're in the U.S. or anywhere globally, search for "Lithium Battery Disposal Near Me" online. Numerous places can safely dispose of these batteries. Make sure to call first to confirm they're open. If you can't find a safe disposal option, contact our customer service team instead of improperly disposing of the battery. We can take care of recycling your batteries for you.

11. Warranty & Returns

In the unlikely event you are having an issue with one of our batteries we have developed a straightforward warranty & return policy which is detailed on ***BigBattery.com/policies*** or in the following link:

https://bigbattery.com/policies/?gad_source=1&gclid=CjwKCAiA6KWvBhAREiwAFPZM7viG8eXNc1fNpm99vxwVI_ptHceLQp0xSAZyxsQD0iizXRI4kTa8ARoCPLgQAvD_BwE#warranty

For more information and support please visit our website and reach us at:

BigBattery LLC.
Technical Support Team
Support@BigBattery.com
(818) 280-3091
400 Maple St.
Commerce, TX 75428

Notes:

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.



SCAN THE QR CODE FOR LATEST VERSION
OF THE USER MANUAL

Need Further Assistance?
Email us at Support@BigBattery.com (OR) Call us at # (818) 280-3091.